


INSTALLATION OF REMOTE INDICATOR

Attaching Remote Indicator Fiber Optic Cable to FI-3C:

Move Plastic Adapter to the end of the fiber optic cable. Push Plastic Adapter into Fiber Connect Cap until it snaps into place.

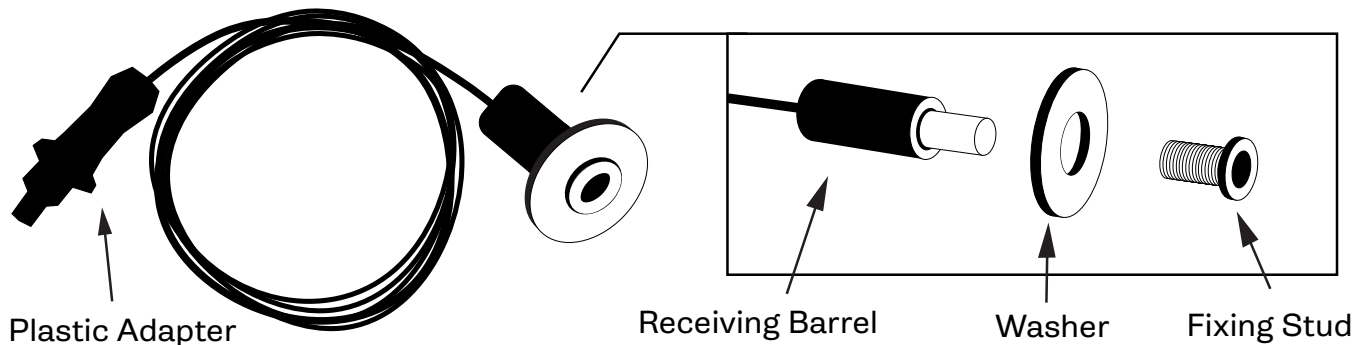

Installation of Remote Indicator's Flashing Point on Transformer Casing:

Drill hole of 5/16" to 7/16" size at installation point.

- **Circle Fixing Stud** - With thumb, apply pressure on Fixing Stud, and unscrew the Receiving Barrel.
- **Hex Fixing Stud** - With a 7/16" head on a ratchet or nut driver, unscrew the Fixing Stud from the Receiving Barrel - use low torque.

Once the Fixing Stud is unscrewed from Receiving Barrel, insert it through the drilled hole and screw the Fixing Stud into the Receiving Barrel until it firmly grips the transformer or switchgear casing.

MANUAL TEST AND RESET

Reset Tool Placement:

Place reset tool over FI-3C so Fiber Connect Cap fits through the open area on the face of the reset tool. When the reset tool rests against the face of the FI-3C, the reset tool's magnet is placed correctly to induce manual test or manual reset.

Remove the magnet from this position once the manual test sequence begins or the manual reset occurs.

Manual Test:

If the reset tool rests in correct placement for 2 seconds, the manual test's LED flashing sequence will begin. First, the LED will flash 2 cycles of red light. If the FI-3C is equipped with the low battery indication option, the LED will then flash two cycles of yellow light. Finally, a slow red cycle indicates that the manual test sequence is over.

Manual Reset:

If the FI-3C's LED is flashing and the reset tool rests in correct placement for 2 seconds, then manual reset will occur - indicated by a single red flash.

FOR ADDITIONAL INSTRUCTIONS, SCAN OR VISIT
SMARTGRIDSOLUTIONS.COM/QRCODE/FI3C_INSTRUCTIONS

